

Measurement & Verification in iBOS[®] Energy


In all projects including Energy Conservation Measurements (*ECM*) it's important to be able verify the savings. This is done through Measurement & Verification (*M&V*) where the International Performance Measurement and Verification Protocol (*IPMVP*) have defined one of the most widely followed best practices in the field.

This white paper aims at explaining the four *M&V* options provided by *IPMVP* and how iBOS[®] Energy lives up to them. In addition to this, the benefits of using the Energy Signature method for normal year correction of energy data is also discussed.

Introduction

The strive to combat climate change and to meet the goals of the Paris climate agreement have put energy efficiency higher and higher on the agenda for many companies and government agencies across the world. In the western countries, buildings and their associated energy consumption make up about 40% of all greenhouse gas emissions which means that their improvement is going to play an important role in meeting these goals (see *Figure 1*) . [1] [2]

Global CO₂ Emissions by Sector

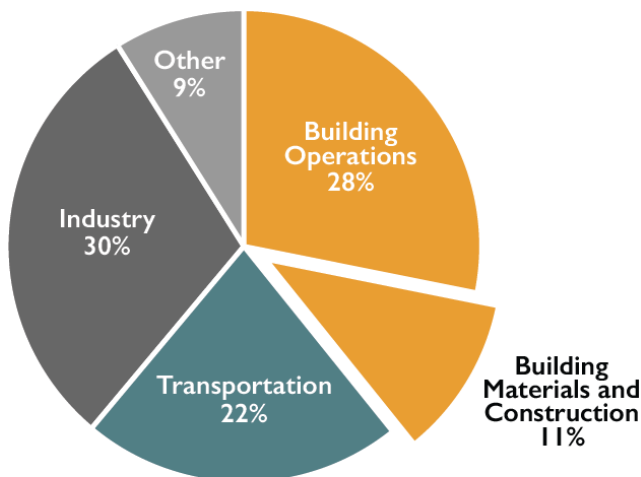

Source: © 2018 2030, Inc. / Architecture 2030. All Rights Reserved. Data Sources: UN Environment Global Status Report 2017; EIA, International Energy Outlook 2017

Figure 1 A global breakdown of how much each sector is contributing to CO₂-emissions

With increased energy prices, transmission costs and taxes comes a financial incentive to do this and it's not uncommon that companies can save 20-40% of their HVAC's energy consumption through the implementation of modern equipment and smarter control strategies with iBOS[®] Energy.

A common way to make such improvements are through Performance-Based Contracts where a company promises to deliver at least a certain amount of savings either with an up-front cost or with the company charging what they've saved for a fixed number of years. Such an approach can minimize the risks for the building owner or building management company, but also requires a well thought out method for *Measurement & Verification* of energy savings that both parties can agree

upon. This whitepaper aims at describing *Measurement & Verification* in general and how iBOS[®] Energy is following the established industry-standard for the same.

Options for Measurement & Verification

The U.S. Department of Energy’s Federal Energy Management Program’s (*FEMP*) guidelines for measurement and verification describe four different Options (A-D) of determining the energy savings from energy efficient equipment, water conservation, improved operation and maintenance, renewable energy, and cogeneration projects. [3] These Options have previously been defined as best practices by the International Performance Measurement and Verification Protocol (*IPMVP*) and are widely recognized by different government agencies across the world. [4] While *IPMVP* have defined a number of Options that should be used for *Measurement & Verification*, they have not made a step by step instruction of how the actual process should be carried out. This decision still remains in the hands of the energy auditor as *IPMVP* recognize that each project will have its’ own possibilities and challenges.

The Options described by *IPMVP* as best practice are:

- A. *Partially Measured Retrofit Isolation*
- B. *Retrofit Isolation*
- C. *Whole Facility*
- D. *Calibrated Simulation*

The different Options are explained in Table 1 below

Table 1 A description of the different best practice options for M&V defined by IPMVP

IPMVP Option	Supported by iBOS® Energy
<p>A. The energy performance of the system to which <i>ECM</i> was applied is measured over a shorter period of time, usually using temporary measurement devices. The results are then extrapolated to calculate what the annual energy consumption of the component should be. This approach is most commonly used for smaller components such as pumps and fans.</p>	No
<p>B. Here the energy performance of the system to which <i>ECM</i> was applied is measured over a longer period of time or continuously. This Option is usually more expensive but has become more readily available over the last few years due to sub metering becoming a standard in new installations and because more expensive pressure modulated pumps and EC-fans may have integrated energy meters that can be connected to the <i>Building Management System (BMS)</i>.</p>	Yes
<p>C. Here the energy usage is measured for the whole facility. The easiest way of doing this is by looking at the bills for gas, district heating, water and electricity but most modern meters also have the ability to report its’</p>	

<p>consumption in real time through an interface like Modbus, BACnet, M-bus, pulse, etc. By comparing the energy usage before and after the <i>ECM</i>, one can see how the change has affected the overall consumption of the media. This Option is best used when major refurbishments have been done, such as the installation of a new boiler or when the control strategy for the building is being changed.</p>	<p>Yes</p>
<p>D. A calibrated simulation means that no actual measurements are made on components or the building itself. Instead a simulation model is created which is supposed to show how the component, system or building would behave during a normal year. This is then compared to the pre-<i>ECM</i> behavior to estimate what the savings should be like. This approach is best used for simple applications such as when ordinary lights are changed to LED. In cases like this, the energy savings can be easily derived from the difference in specifications. For larger application this approach usually requires substantial knowledge about computer modeling as well as specialized software to run the simulations.</p>	<p>No</p>

iBOS® Energy connects to all of the available main- and sub-meters in a building to gather its’ energy data. The data can be gathered from any source that supports *BACNet*, *Modbus* or *JSON-RPC* which means that the source could be both a *BMS*, a gateway or the meter itself. All of this means that iBOS® Energy is compliant with *IPMVP*’s standards for both *Option B* and *Option C* when it comes to *Measurement & Verification*.

Energy Signature – The most reliable way to do normal year correction of energy data

iBOS® Energy uses the Energy Signature method for normalization and verification of savings which has several advantages over other common methods such as Degree Day Compensation. CIT Energy Management AB [5] have compared different methods of normalizing energy data and they found that the Energy Signature gave the most accurate monthly compensation over a range of building types and weather conditions. Their study is backed by another paper published by The Swedish Energy Agency [6]. Together they’ve identified the following advantages with the Energy Signature method:

1. The Energy Signature method can be used with any building regardless of its’ balance point temperature. Degree Days are usually generated for a model building with a high balance point temperature and the more the model differs from the actual building, the more error you’re going to get when you normalize your energy data.
2. The Energy Signature method uses the local weather for its’ calculations which may differ significantly from the nearest weather station, especially in crowded cities.
3. The Energy Signature method allows you to compare buildings that are situated in different cities or even countries, regardless of what the annual average temperature is on site. This means that you can objectively compare buildings to one another to determine which has the

best fabric or system setup. An example of how the temperature may differ in different parts of a country can be seen in *Figure 2*.

More and more professionals are starting to use the Energy Signature method and it is used by both energy consultants, researchers, government agencies and energy companies for normal-year correction of energy data and load prediction.

Below is a description of the methodology used by iBOS® Energy in creating an Energy Signature for measurement and verification.

Acquiring Baseline Data

To create the baseline of a building or a system in an iBOS® Energy project, monthly non normalized energy data from a reference year is required. Data from logs in the BMS or other 3rd party system as well as CSV- or other data-files, monthly bills etc. can all be used for this. The data is preferred to be based on calendar months but if there are overlaps it can still be used with the help of analysis software and extrapolation techniques.

Determining and normalizing the Baseline

The next step in the process is to determine whether the measured systems have a *Temperature Dependent Load* or not. This is done by analyzing the energy consumption data looking for differences in consumption based on time of year and average temperatures. An example of what that may look like is shown in *Figure 3* and *Figure 4*.

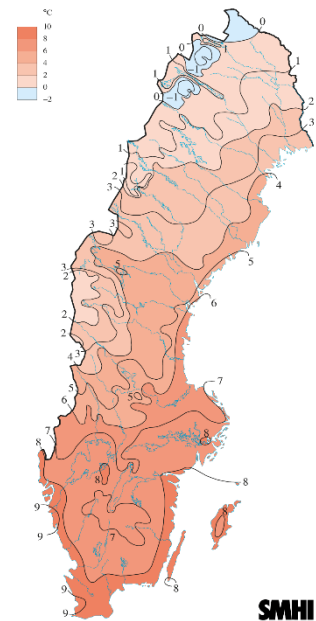


Figure 2 The annual average temperature of different regions in Sweden. With the Energy Signature, buildings in different climate zones can be compared against one another

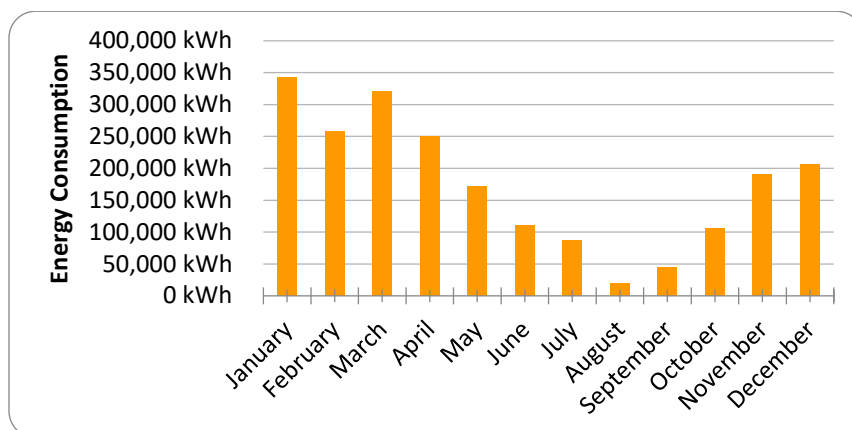


Figure 3 The gas consumption per month before the implementation of iBOS® Energy. The sinus-formed trend is an indication that a Temperature Dependant Load is present



SMART BUILDINGS START HERE

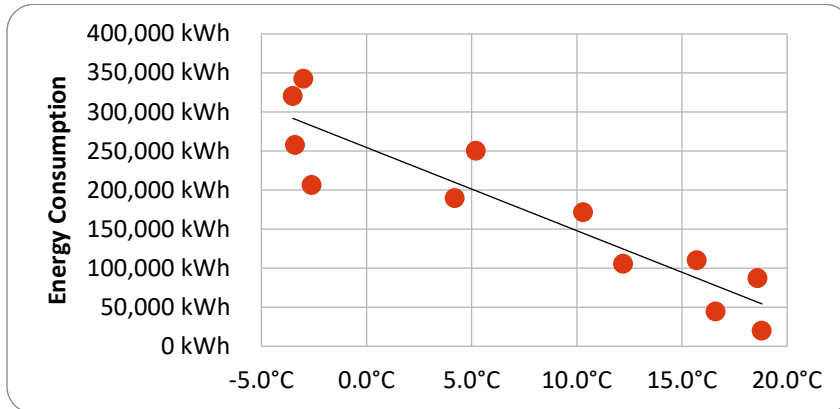


Figure 4 The gas consumption each month plotted against the average temperature of the same month. Here a clear pattern can be seen with higher consumption at lower temperatures. This is proof of a Temperature Dependent Load

Next, the *Base Load* and the *Temperature Dependent Load* are calculated using the reference year's average temperature and entered to form a baseline of comparison in the Energy Signature. By entering the normal annual average temperature for the location as recorded by the country's national weather institute this baseline is now corrected to reflect the energy consumption as it would be in a normal year.

Calibration of the Energy Signature

When we have a full month of readings from an outdoor temperature sensor that is unaffected by sunshine, we can compare that sensor's average reading to the closest official weather station to compensate for the micro-climate that this specific building is experiencing.

Adding additional Reference Lines

With iBOS® Energy controlling the building we expect a significant reduction in energy usage. In the heating case however, the *Base Load* won't change, nor will the buildings' thermal performance (it's *Temperature Dependent Load*) so what we will affect with iBOS® Energy is the building's *Balance Point Temperature*, meaning in this case the outdoor temperature when the heating system needs to turn on. By using a smarter control strategy and by using the available free heat that we get from internal loads and sunny weather we can delay when we need to turn the heating system on, thus saving energy. Our savings estimates are experience based and by trying new *Balance Point Temperatures* we will eventually end up with another reference line that represents the savings that we expect to see. This is something that can be added to the Energy Signature as an additional reference line (see Figure 3). Other things that one might want to visualize are future energy goals for the building and past outcomes at the end of each year. Since iBOS® Energy doesn't have any restrictions of how many reference lines you can have, the Energy Signature can easily be modified to give you the statistics that you're looking for right now.

< Energy signature - Värme-VS1

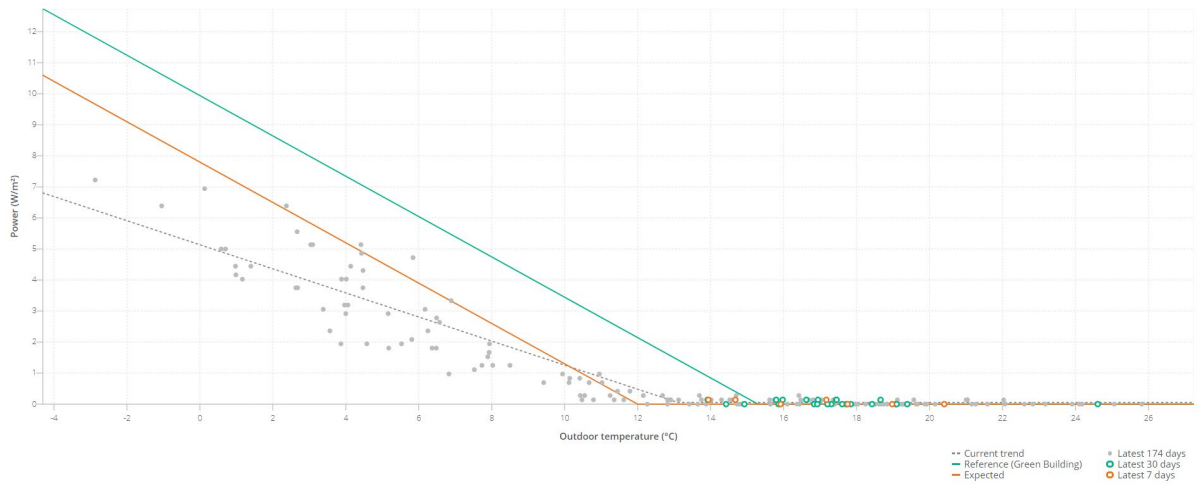


Figure 5 An Energy Signature for the heating system VS1 with a Baseline (Reference), another Reference Line (Expected) and with the Current Trend. Note that the Current Trend only entails 174 days of data and that the accuracy of the signature will improve when a full year of data has been acquired.

Comparing the buildings' current performance to the Reference Lines

At the end of each day we will plot the daily mean specific power usage together with these reference lines and in time we will end up with an energy pattern of our own, namely the *Current Trend* which can also be seen in Figure 3. By comparing this trendline to our reference lines we can easily determine how large the savings are. This information together with some other calculated performance indicators make up our *Key Performance Indicators* seen in Figure 4. All of these indicators are relevant when comparing different buildings to one another and together they give you a good understanding of how well the buildings are performing.

Key performance indicators

Estimated annual energy consumption	Estimated power at 0 °C	Estimated power at -13 °C
73 MWh 24 kWh/m²	5.1 W/m² 15 kW	31 kW 10 W/m²
Difference compared to line Reference (Green Building)		Difference compared to line Expected
-51.7 % -3 W/m²		-30.9 % -1.2 W/m²

Figure 6 The Key Performance Indicators for how the heating system VS1 is performing with iBOS® Energy

The actual energy usage is also saved in tables for future reference or for analysis by a 3rd party.

Conclusion

iBOS® Energy complies with IPMVP's Option B and Option C regarding Measurement & Verification. The iBOS® Energy software uses the Energy Signature method to normalize energy data and to calculate the achieved energy savings. The benefits of the Energy Signature method are that accurate savings and load estimate calculations can be made for buildings with different balance point

temperatures situated in different climate zones while considerations are made to every building's unique micro-climate.

References

- [1] United States Green Building Council, "Buildings and Climate Change".
- [2] Swedish Environmental Protection Agency, "Naturvårdsverket," 26 08 2019. [Online]. Available: <https://www.naturvardsverket.se/Miljoarbete-i-samhallet/Miljoarbete-i-Sverige/Uppdelat-efter-omrade/Energi/Energieffektivisering/Bostader-och-lokaler/>. [Använd 26 08 2019].
- [3] U.S. Department of Energy, "M&V Guidelines: Measurement and Verification for Performance-Based Contracts Version 4.0," U.S. Department of Energy, 2015.
- [4] International Performance Measurement & Verification Protocol Committee, "International Performance and Verification Protocol: Concepts and Options for Determining Energy and Water Savings Volume 1," 2002.
- [5] L. Schulz, "Normalårskorrigerig av energianvändningen i byggnader - en jämförelse av två metoder," EFFEKTIV, 2003.
- [6] C. Heincke, L. Jagemar och P.-E. Nilsson, "Normalårskorrigerig av Energistatistik," The Swedish Energy Agency, Gothenburg, 2011.